


TAG NO.  
6-UPP-1C  
6-UPP-3

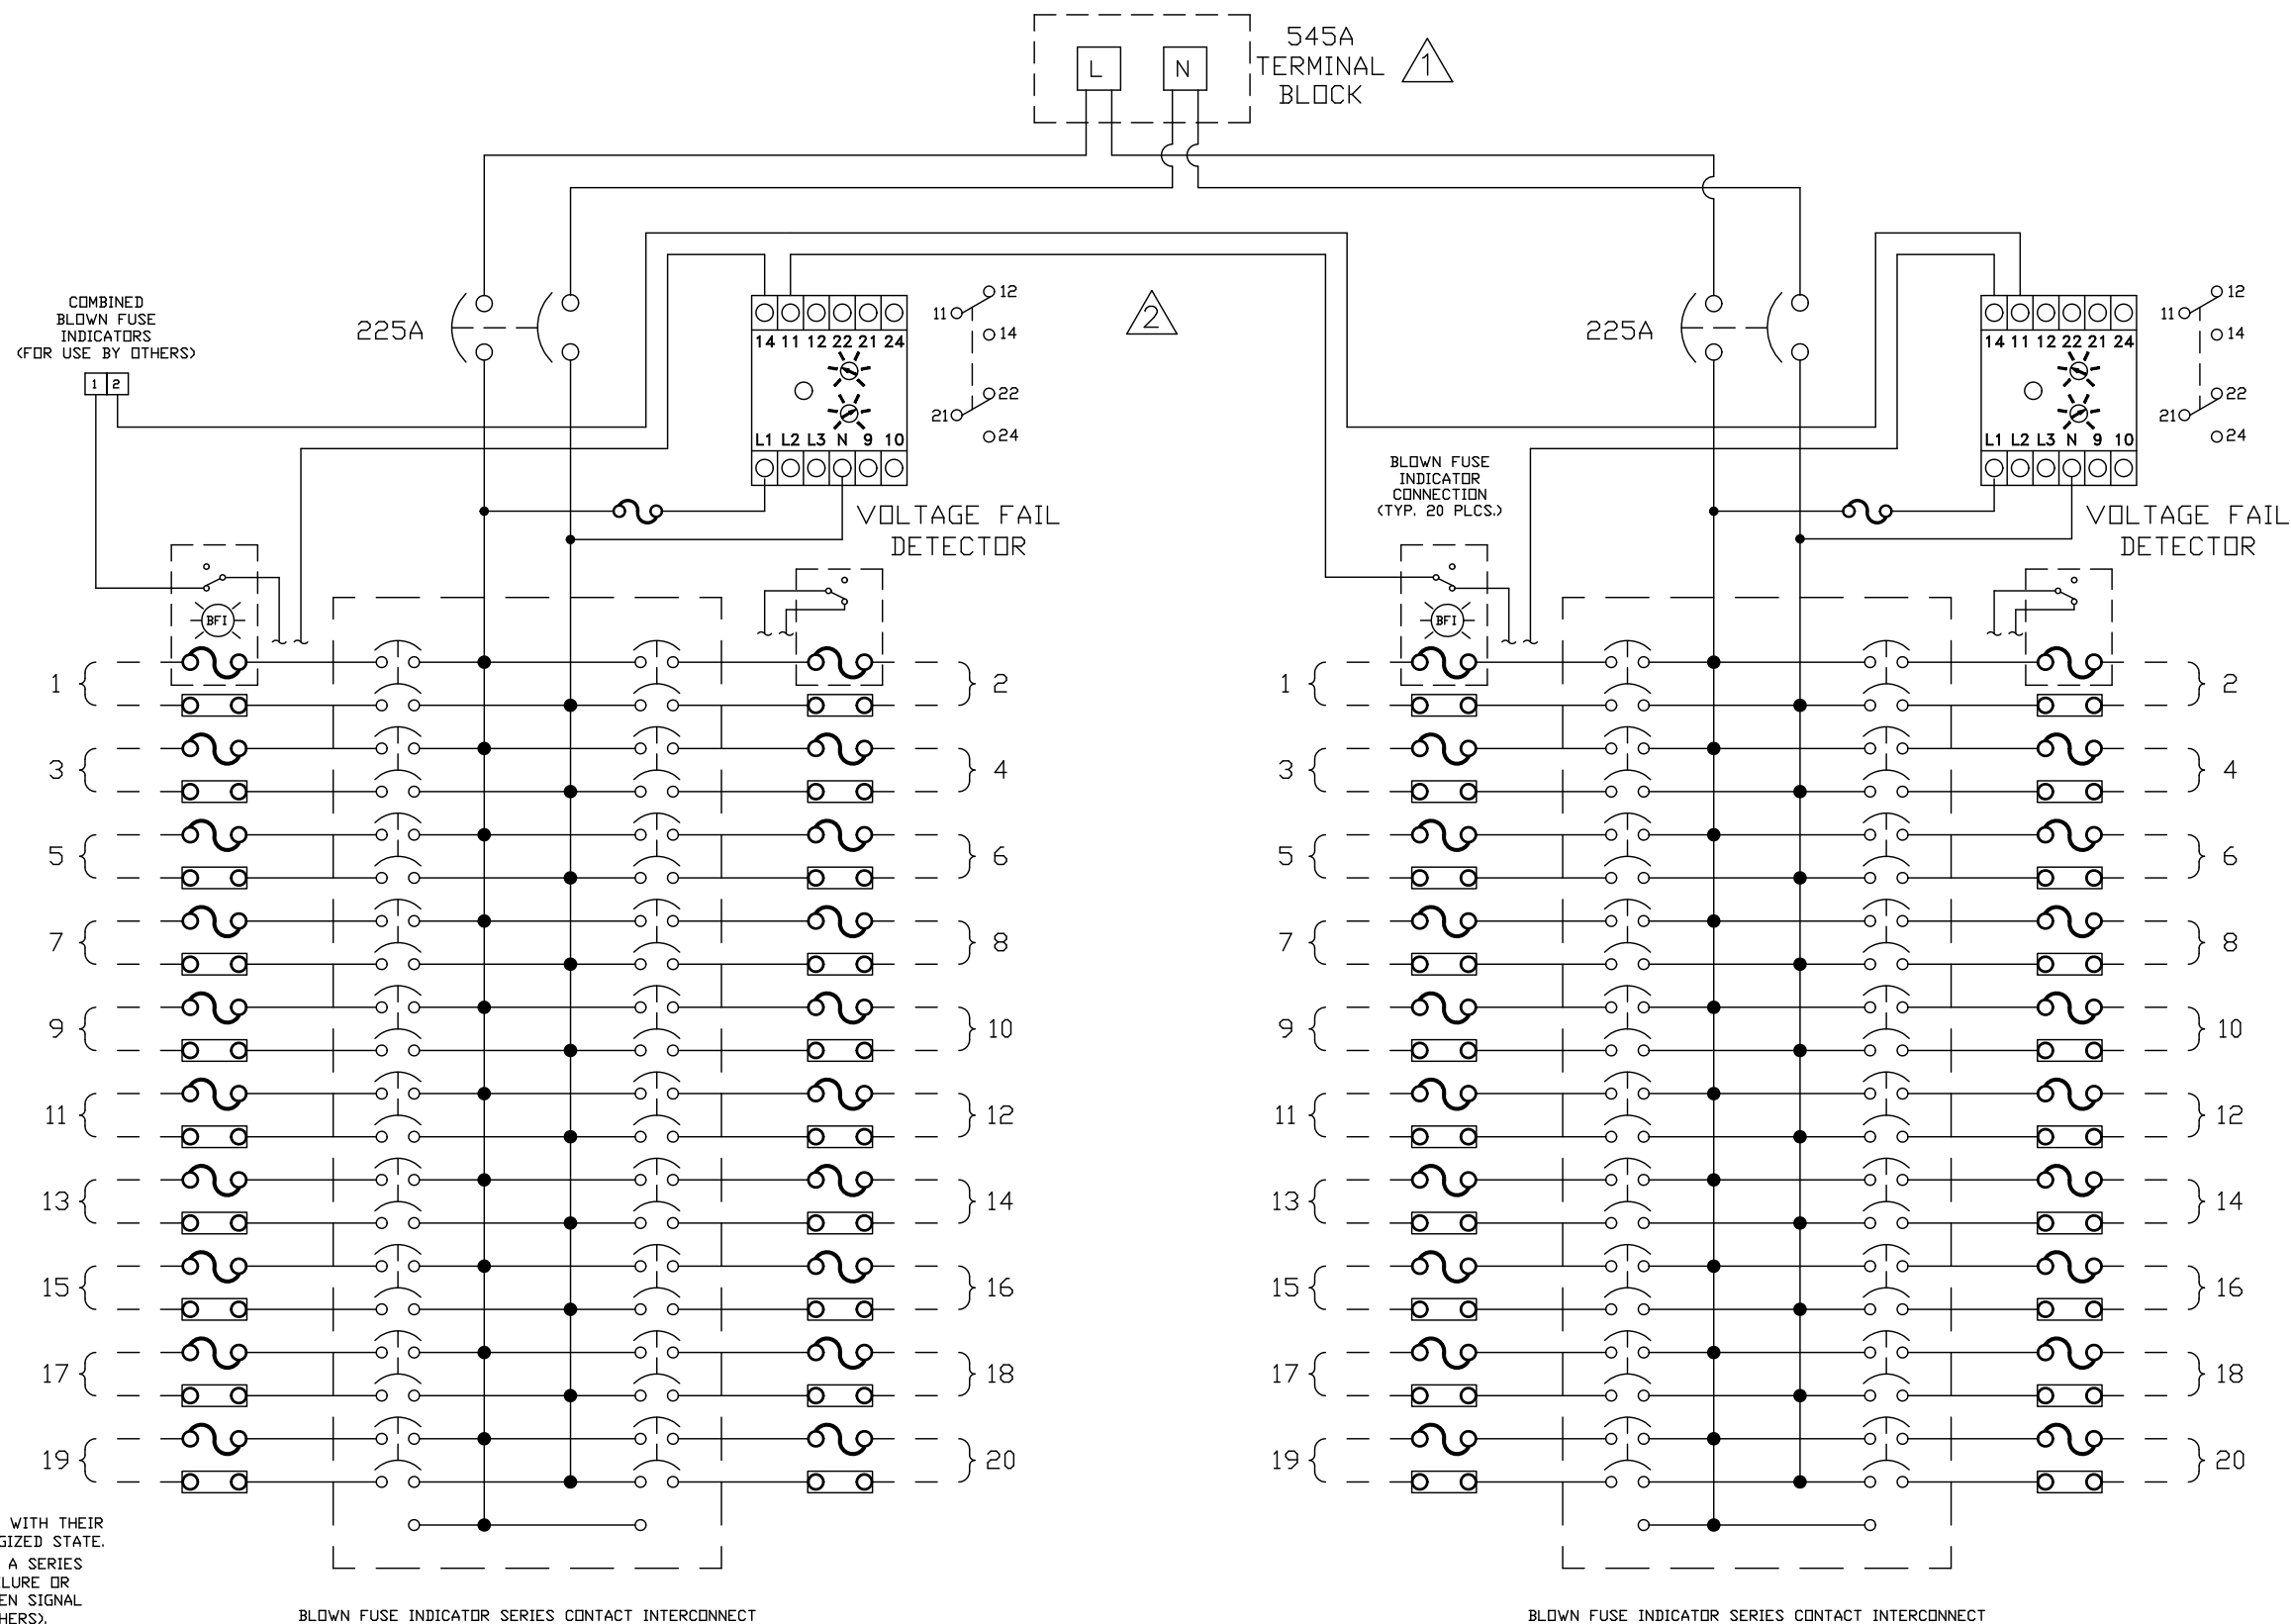

COMBINED  
BLOWN FUSE  
INDICATORS  
(FOR USE BY OTHERS)

225A

545A  
TERMINAL  
BLOCK

225A

BLOWN FUSE  
INDICATOR  
CONNECTION  
(TYP. 20 PLCS.)

VOLTAGE FAIL  
DETECTOR

VOLTAGE FAIL  
DETECTOR

BLOWN FUSE INDICATOR SERIES CONTACT INTERCONNECT

BLOWN FUSE INDICATOR SERIES CONTACT INTERCONNECT

NOTE: ALL ACTIVE DEVICES SHOWN WITH THEIR CONTACTS IN A POWER OFF, DENERGIZED STATE. ALL CONTACTS ARE CONFIGURED IN A SERIES ARRANGEMENT SO THAT A FUSE FAILURE OR POWER LOSS WILL PROVIDE AN OPEN SIGNAL TO A REMOTE ANNUNCIATOR (BY OTHERS).

XX					
XX		DD-MM	XXXX	RDP	DTL
NO.	DESCRIPTION	DATE	DRAWN BY	CHECKED BY	APPROVED BY
REVISIONS					
VENDOR NAME					
PROJECT NAME: ESCRAVOS GAS TO LIQUIDS PROJECT					
EQUIPMENT / MATERIAL NAME:					
DRAWING TITLE:					
EGTL1 DOCUMENT NUMBER:				REV. NO.	
CNL P. O. NO.: EGTL1-MGN-PRC-PO-000015					

1	REVISED DUAL TO SINGLE INPUT; CHANGED ALARMS FROM A PARALLEL TO A SERIES CONNECTION	GBY		12/13/06	4	-	-	-
					3	-	-	-
ISSUE	DESCRIPTION	BY	APPVD	DATE	2	REV. TITLEBLOCK AND ALARM CONN.	GBY	04/05/07
UNLESS OTHERWISE SPECIFIED: ALL DIMENSIONS IN INCHES INSIDE BEND RADIUS .030 MAX REMOVE ALL BURRS AND SHARP EDGES		TOLERANCE: X.XX = ±.030 X.XXX = ±.015		HOLE Ø = ±.005 ANGLE = ±1/2°		MATERIAL: - FINISH: -		

# UNITED POWER

**DANAHER**  
POWER SOLUTIONS  
6900 EASTPORT BLVD - RICHMOND, VA 23231-4483

This document is the property of Danaher Power Solutions LLC. Under copyright law, distribution and reproduction of this document, in whole or in part, is prohibited without prior written permission from Danaher Power Solutions LLC.

ITEM NO.: 990503801000

STATUS	SCALE	DRWN: GBY	CHKD: -
ORDER	-	APPVD: -	DATE: 11/13/06
TITLE 400A, 1 PHASE, 1 INPUT 2 PNLBRDS W/BLOWN FUSE INDICATORS, 40 CKT			DWG. SIZE, NUMBER 03801-SPB REV. NO. 2
SHEET 1			OF 1