


TAG NO.
 1-UPP-1A1
 1-UPP-1B1
 1-UPP-1C1
 2-UPP-1A1
 2-UPP-1B1
 2-UPP-1C1
 2-UPP-5A1
 2-UPP-5B1
 2-UPP-5C1

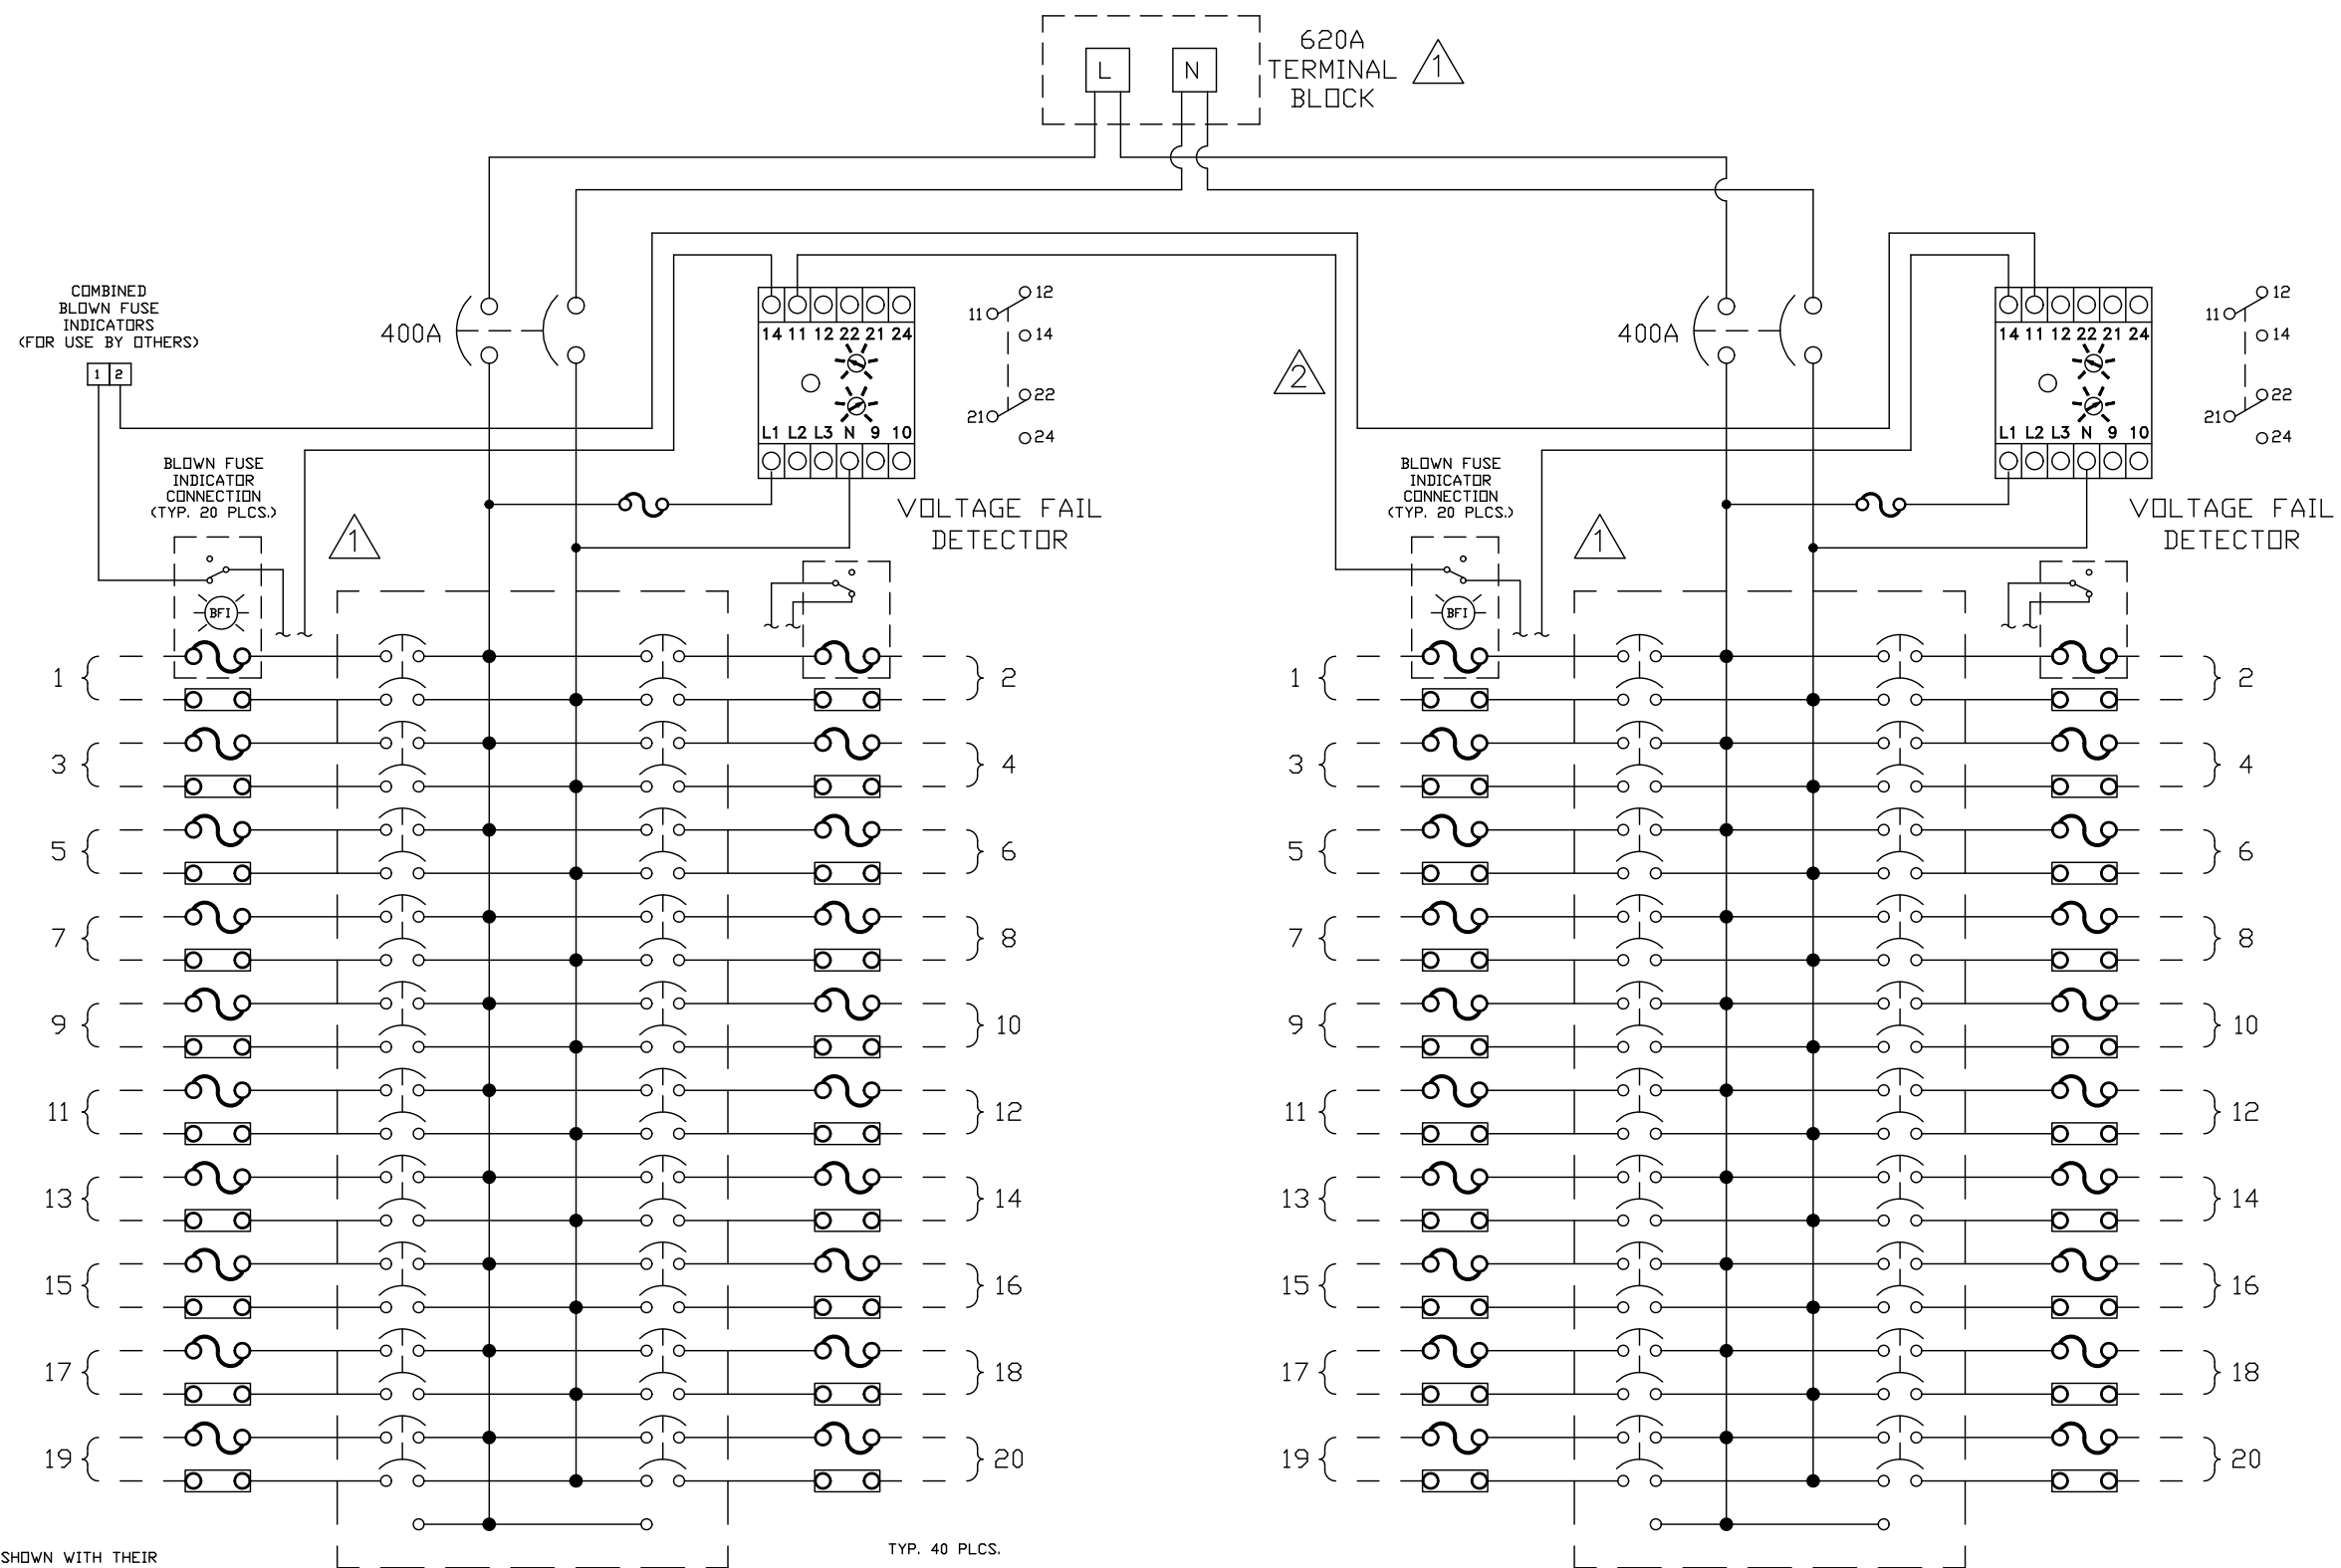

NOTE: ALL ACTIVE DEVICES SHOWN WITH THEIR CONTACTS IN A POWER OFF, DENERGIZED STATE.
 ALL CONTACTS ARE CONFIGURED IN A SERIES ARRANGEMENT SO THAT A FUSE FAILURE OR POWER LOSS WILL PROVIDE AN OPEN SIGNAL TO A REMOTE ANNUNCIATOR (BY OTHERS).

BLOWN FUSE INDICATOR SERIES CONTACT INTERCONNECT

BLOWN FUSE INDICATOR SERIES CONTACT INTERCONNECT

XX					
XX		DD-MM	XXXX	RDP	DTL
NO.	DESCRIPTION	DATE	DRAWN BY	CHECKED BY	APPROVED BY
REVISIONS					
VENDOR NAME					
PROJECT NAME: ESCRAVOS GAS TO LIQUIDS PROJECT					
EQUIPMENT / MATERIAL NAME:					
DRAWING TITLE:					
EGTL1 DOCUMENT NUMBER:				REV. NO.	
CNL P. O. NO.: EGTL1-MGN-PRC-PO-000015					

1	REVISED DUAL TO SINGLE INPUT; CHANGED ALARMS FROM PARALLEL, TO A SERIES CONNECTION	GBY	-	12/06/06	4	-	-	-
					3	-	-	-
ISSUE	DESCRIPTION	BY	APPVD	DATE				
	REV. TITLE: BLOWN FUSE INDICATOR AND ALARM CONN	GBY	-	04/05/07				

UNITED POWER

 6900 EASTPORT BLVD - RICHMOND, VA 23231-4483
 This document is the property of Danaher Power Solutions LLC. Under copyright law, distribution and reproduction of this document, in whole or in part, is prohibited without prior written permission from Danaher Power Solutions LLC.

ITEM NO.: 990503802000			
STATUS	SCALE	DRWN: GBY	CHKD: -
ORDER	-	APPVD: -	DATE: 11/13/06
TITLE: 600A, 1 PHASE, 1 INPUT 2 PNLBRDS W/BLOWN FUSE INDICATORS, 40 CKT		DWG. SIZE, NUMBER	REV.
		03802-SPB	2
		SHEET 1	OF 1

UNLESS OTHERWISE SPECIFIED: ALL DIMENSIONS IN INCHES INSIDE BEND RADIUS .030 MAX REMOVE ALL BURRS AND SHARP EDGES	TOLERANCE: x.xx = ±.030 x.xxx = ±.015	HOLE Ø = ±.005 ANGLE = ±1/2°	MATERIAL: - FINISH: -
--	---	---------------------------------	--------------------------