

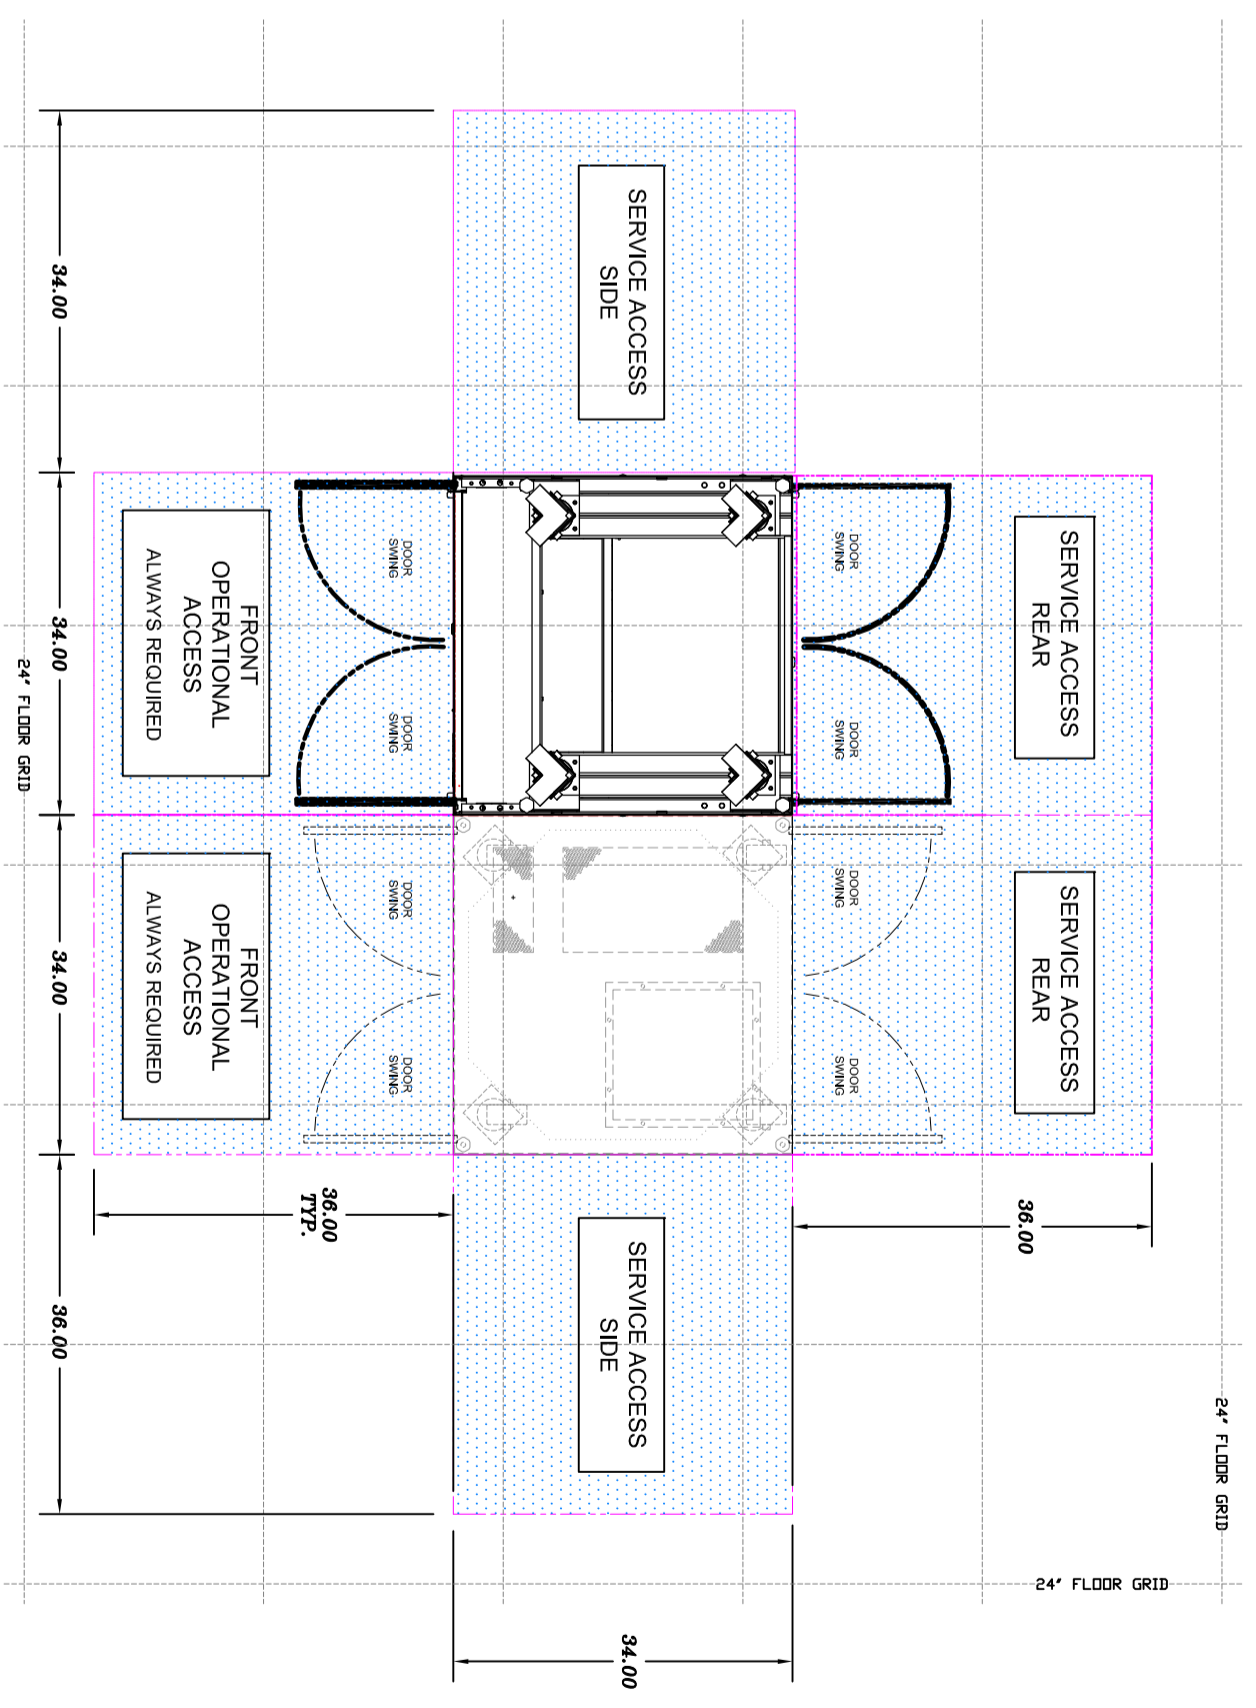
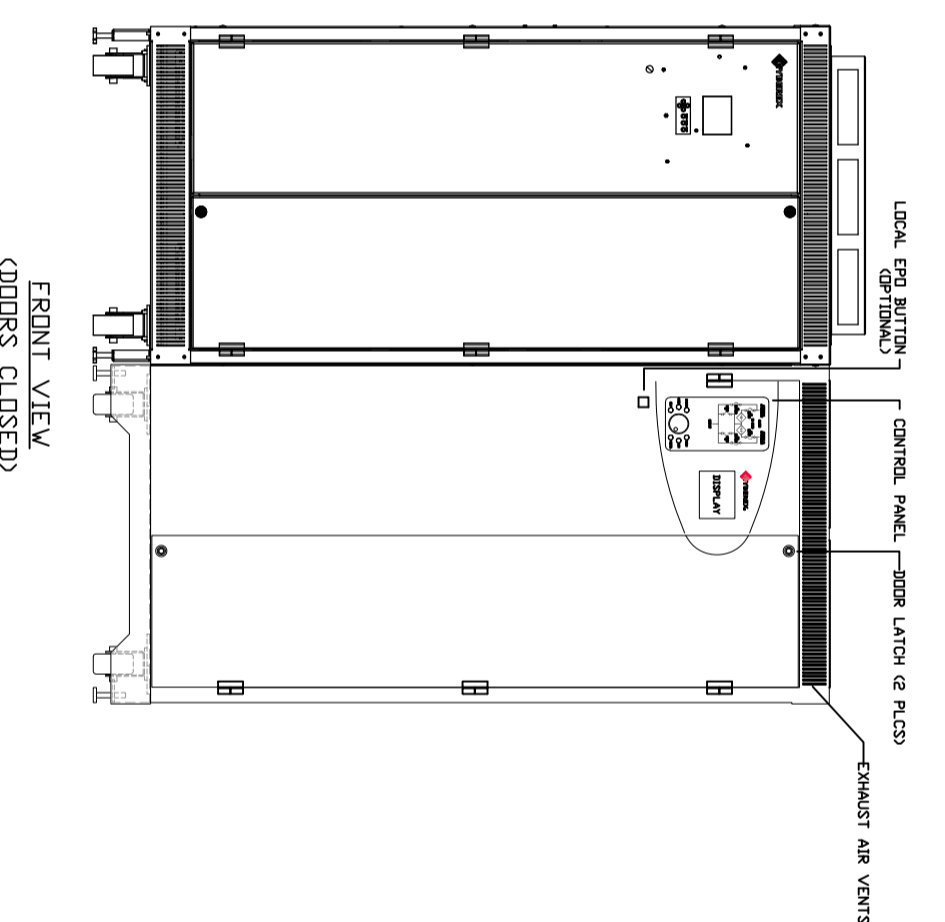
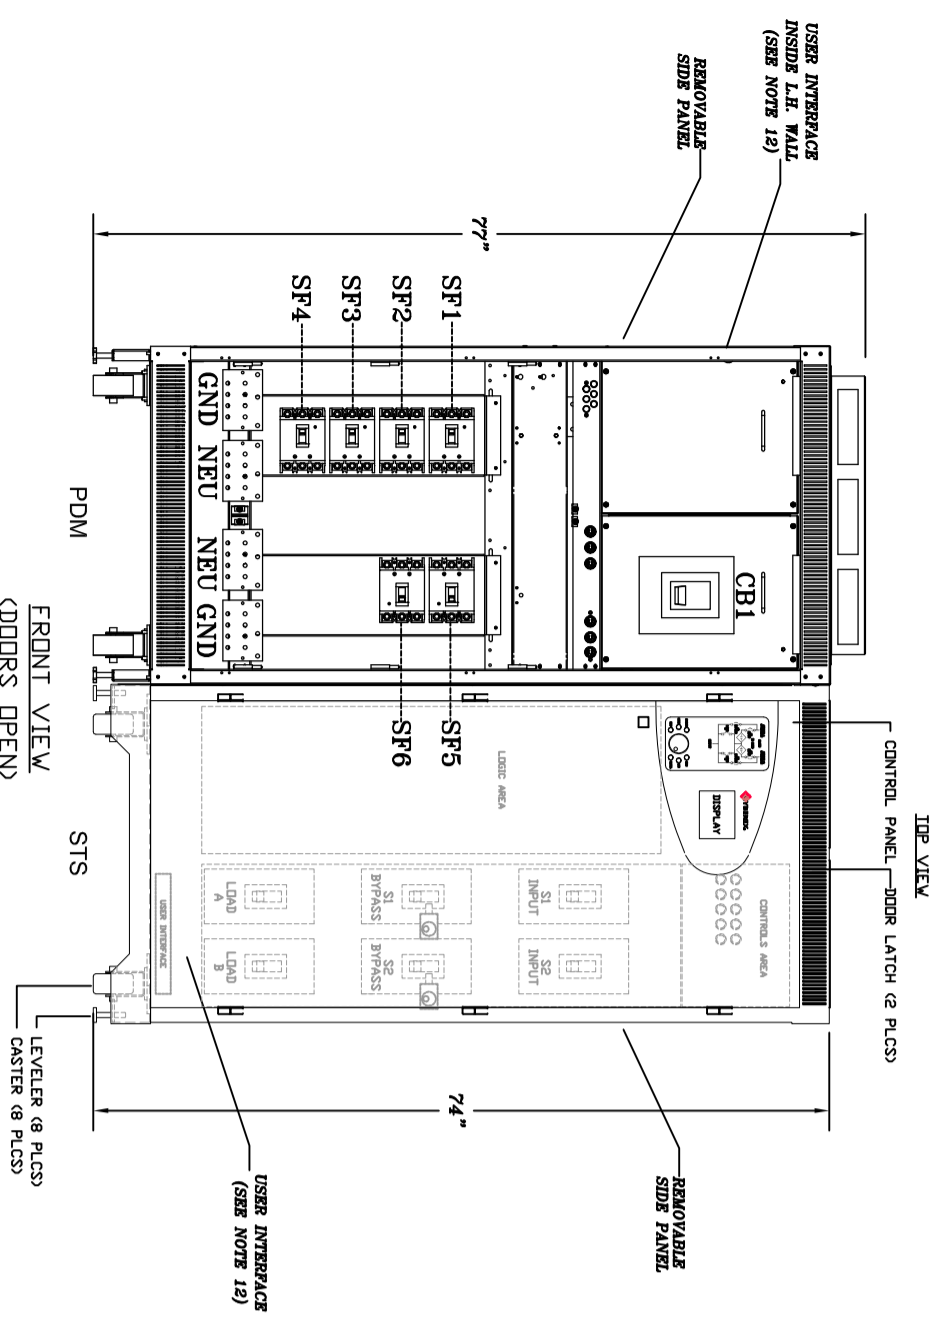


System Model #	Dim. (W*D*H)	BRTU/hr.	WEIGHT /lbs
MC11.2-2-BMM-300-K13-426	68" x 34" x 77"	26,930	4000

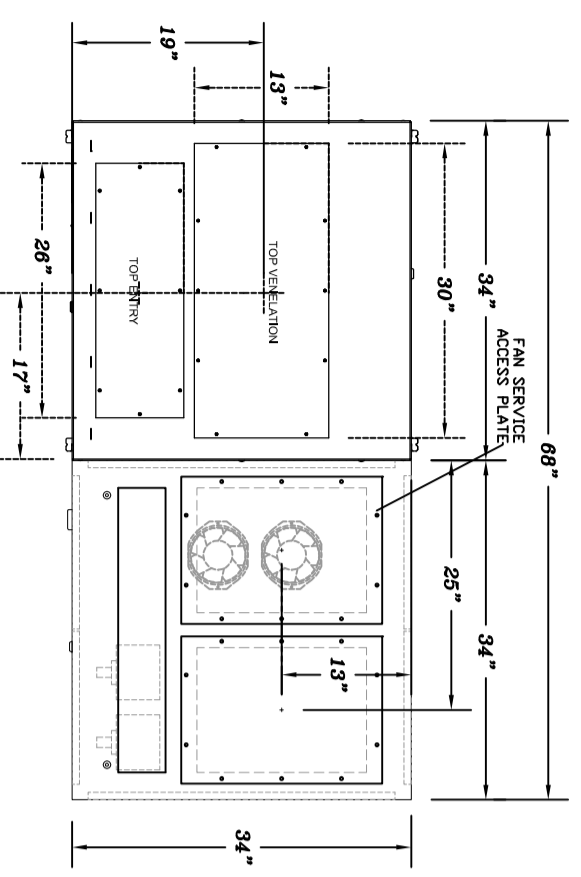

NOTES:

1. ALL DIMENSIONS EXPRESSED IN INCHES.
2. AMBIENT TEMPERATURE RANGE: 0° TO 40°C.
3. SYSTEM COOLING REQUIREMENTS:
 - SS3 - FORCED AIR COOLED
 - PDM - NATURAL CONVECTION COOLED.
4. WEIGHT: SS3 - 1200 LBS (400A)
PDM2 - 2,800 LBS
5. OPERATIONAL ACCESS VIA FRONT DOORS.
6. MAINTENANCE AND CONNECTION ACCESS:
 - PDM - VIA FRONT/REAR DOOR, SIDE
 - PDM XFMR INFRARED SCAN VIA REMOVABLE SIDE PANEL/ REAR DOOR
 - SS3 - VIA FRONT/REAR DOORS AND REMOVABLE SIDE PANEL.
7. RECOMMENDED MINIMUM CLEARANCES:
 - FRONT - 36.00
 - REAR SS3 - 30" MIN., 36" IF AVAILABLE
 - REAR PDM - 30" MIN., 36" IF AVAILABLE
 - MISSION CRITICAL RIGHT SIDE - 36.00
 - MISSION CRITICAL LEFT SIDE - 36.00
 - TOP - 20.00
8. SYSTEM MUST HAVE ALL PANELS AND DOORS INSTALLED FOR PROPER OPERATION.
9. FOR DETAILED SS3 OUTLINE, REFER TO DRAWING C65206-1
10. SS3 NEUTRAL IS FIXED GUN-SWITCHED)
11. BOTTOM CABLE ENTRY/EXIT ONLY FOR PDMs
12. RS485 COMMUNICATION PORTS AVAILABLE ON USER INTERFACE BOARDS
13. STABILIZING FEET SHOULD NOT BE USED TO LIFT EQUIPMENT.

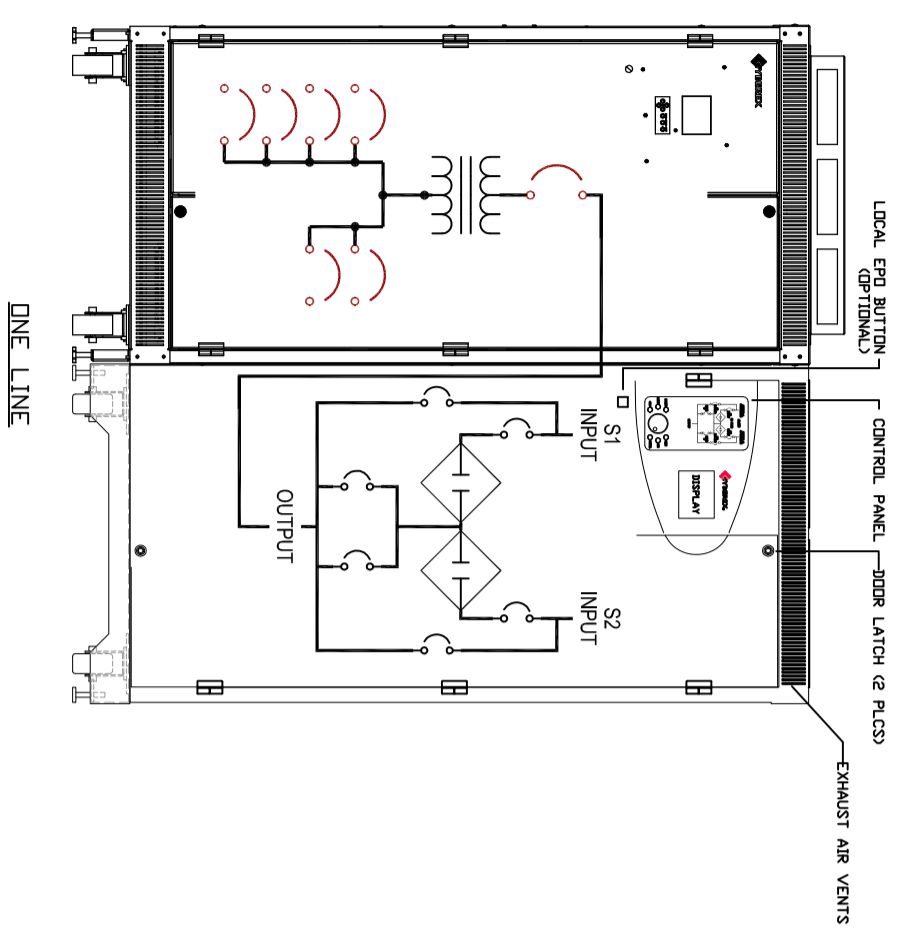

ISSUE	DESCRIPTION	BY	APPVD	DATE
-	-	-	-	-
-	-	-	-	-
A	RELEASED	GBY	-	11/09/07

STATUS	SCALE	DRWN:	GBY	CHKD:	DATE:
ORDER	-	APPVD:	-	-	11/09/07
TITLE	MC11.2 300KVA K13	DWG. SIZE NUMBER	1	REV	
	6 SUB-FEED BREAKERS	0003484-12-2	A		
	400A SS3, OUTLINE DIAGRAM	SHEET	1	OF	1